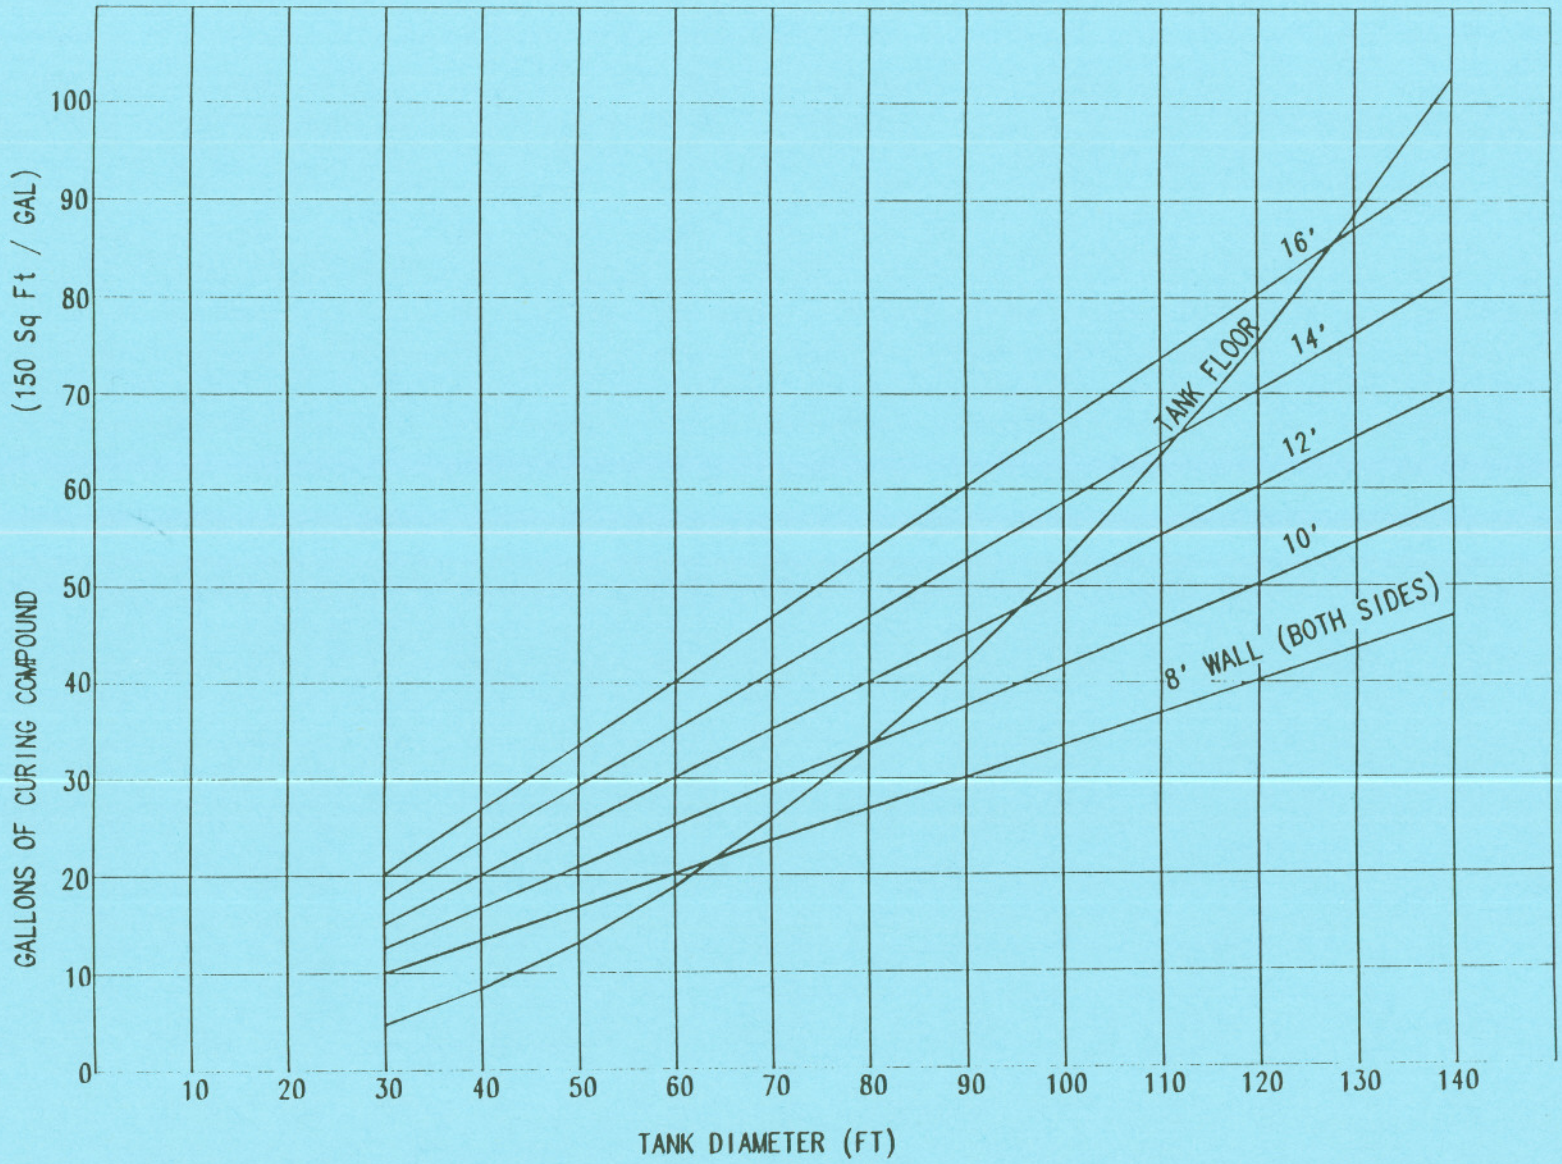CURING COMPOUND REQUIRED FOR CIRCULAR TANKS