
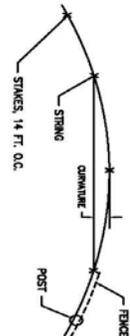


### BILL OF MATERIALS

ITEM	UNIT	DIAMETER SQUARE OR SIZE	LENGTH	QUANTITY
CORNER OR END POST, WOOD	EACH	6"		
BRACE POST, WOOD	EACH	5"		
LINE POST, WOOD	EACH	3" TREATED, 4" UNTREATED		
BRACE POLE, WOOD	EACH	3 1/2"		
GAZE POLE, WOOD	EACH	3"		
STEEL PIN	EACH	1/4"	4"	
LINE POST, STEEL	EACH			
BARBED WIRE - 4 FT G.A.U.V.	LN. FT.	12 1/2 GAUGE		
WOODEN WIRE G.A.U.V.	LN. FT.	1047-12-11		
WOODEN WIRE G.A.U.V.	LN. FT.	1047-9-11		
WOODEN WIRE G.A.U.V.	LN. FT.	932-9-9		
WOODEN WIRE G.A.U.V.	LN. FT.	939-9-9		
STAPLES G.A.U.V.	LSB.	9 GAUGE	1 1/4"	
BRACE WIRE G.A.U.V.	LSB.	9 GAUGE		
GATES	EACH		12'-0"	
TREATED GATE - LUMBER PER GATE				
HORIZONTAL MEMBERS	EACH	1" X 6"	12'-0"	4
VERTICAL MEMBERS	EACH	1" X 6"	3'-6"	8
DIAGONAL MEMBERS	EACH	1" X 4"	6'-8"	4



**FENCE CURVATURE**

**REQUIRED FENCE PROTECTION FROM LIGHTNING**

1. FENCE SHALL BE GROUNDED EVERY \_\_\_\_\_ FEET IN LENGTH AS A MINIMUM.
2. THE ALL WIRES (3 WAYS) WITH 9 GAUGE GALVANIZED WIRE TIES TO FENCE GROUNDED ELECTRODES.
3. ELECTRODES MUST BE EITHER STAINLESS GALVANIZED STEEL FENCE POSTS, NEW 3/4\"/>
4. ELECTRODES MUST BE EITHER STAINLESS GALVANIZED STEEL FENCE POSTS, NEW 3/4\"/>
5. FENCES CONSTRUCTED USING STEEL LINE POSTS PROPERLY INSTALLED WILL NOT REQUIRE GROUNDED.
6. FENCES WILL HAVE A CONTINUITY BREAK EVERY 1000' OR LESS.

FENCE HEIGHT \_\_\_\_\_ INCHES  
 NUMBER OF WIRE STRINGS 3/4"  
 WOOD POSTS SHALL BE EITHER:  
 4. UNTREATED  
 5. PRESSURE TREATED

IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH PA ACT 287 (1974) AS AMENDED BY ACT 189 (2004) BEFORE DOING ANY EXCAVATION WORK OR DRIVING ANY FENCE POSTS.

NOT TO SCALE

REDRAWN: TJA 7/05

Designed by	S. KUTNER	Date	5/09
Drawn by	S. KUTNER	Date	5/09
Checked by			
Approved by			



\_\_\_\_\_ COUNTY, PENNSYLVANIA  
**WOVEN WIRE FENCE**