


PA-057A 4' Dry Hydrant - Vertical
Standard Drawings Folder

FIRE COMPANY CERTIFICATION:
NAME & TITLE _____
NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:
NAME & TITLE _____

FREEZE PROTECTION
8" PVC FROM HEAD ASS'Y TO BELOW NORMAL WATER: ANNUAL SPACE FILLED WITH INSULATION FOAM. (PREMOULDED OR EXPANDING FOAM)
GUARD POSTS - SEE NOTE #1
YES ___ NO ___

ITEM	MARK	QUAN.	UNIT
4" HYDRANT ASSEMBLY - 90° BEND	1	1	EACH
HYDRANT CAP	2	1	EACH
3" PVC STRAINER	3	1	EACH
4" SCH. 40 PVC 90° ELBOW	4	1	LN., FT.
4" SCH. 40 PVC PIPE-RISER	5	1	LN., FT.
4" SCH. 40 PVC PIPE	6	1	EACH
4" SCH. 40 PVC COUPLINGS	7	1	EACH
4" STRAINER CAP	8	1	CAN.
PRIMER CLEANER			CAN.
PVC GLUE			CAN.
UNDER-WATER SUPPORT	9	1	LN., FT.
8" SCH. 40 PVC PIPE	10	1	LN., FT.
8" SCH. 40 PVC CAP	11	1	EACH

POOL	ITEM	SITE DATA	ACRES
DROUGHT POOL			—
MINIMUM DRAW			—
MAXIMUM DRAW			—
AVAILABLE WATER AT NORMAL LEVEL			—
AVAILABLE WATER AT DROUGHT LEVEL			—

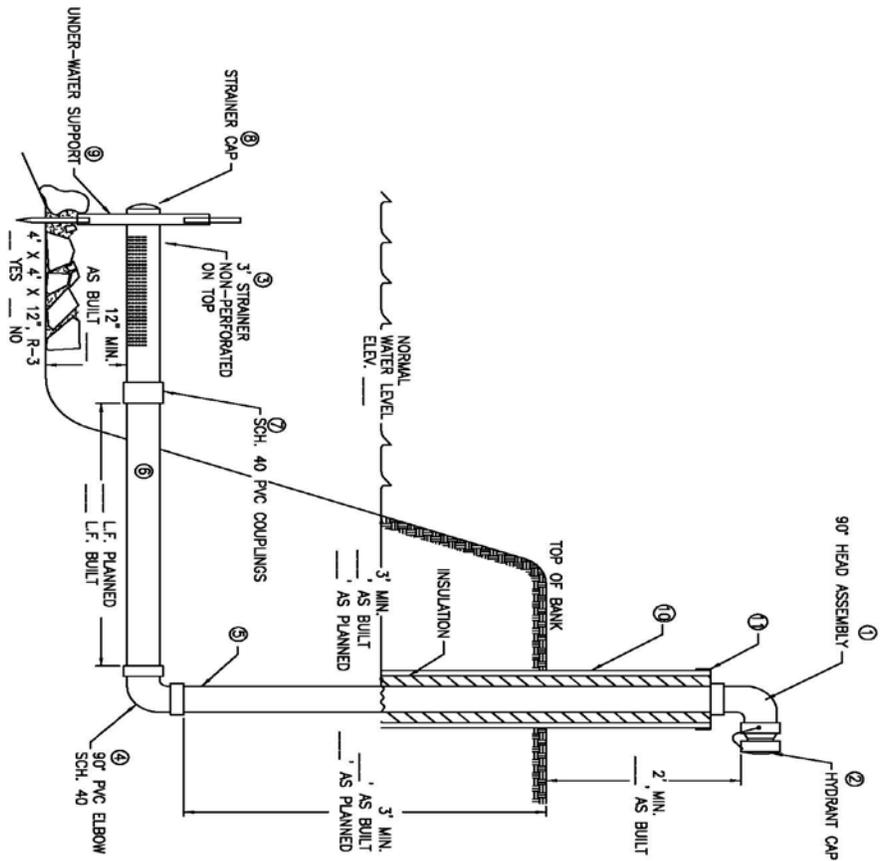

NOTES:
1. FOR GUARD POSTS, IF REQUIRED, SHALL BE _____
2. UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR CONSTRUCTED FOR LOCAL CONDITIONS.

NOT TO SCALE