


PA-057B 6' Dry Hydrant - Vertical
Standard Drawings Folder

FIRE COMPANY CERTIFICATION:
NAME & TITLE _____
NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:
NAME & TITLE _____

FREEZE PROTECTION YES NO
10" PVC FROM HEAD ASS'Y TO BELOW NORMAL WATER. ANNULAR SPACE FILLED WITH INSULATION FOAM. (PREMULDED OR EXPANDING FOAM)
GUARD POSTS -- SEE NOTE #1
YES NO

ITEM	MARK	QUAN.	UNIT
6" HYDRANT ASSEMBLY - 90° BEND	1	1	EACH
HYDRANT CAP	2	1	EACH
6" 3' PVC STRAINER	3	1	EACH
6" SCH. 40 PVC 90° ELBOW	4	1	EACH
6" SCH. 40 PVC PIPE-RISER	5	1	LN., FT.
6" SCH. 40 PVC PIPE	6	1	LN., FT.
6" SCH. 40 PVC COUPLINGS	7	1	EACH
6" STRAINER CAP	8	1	EACH
PRIMER CLEANER			CAN.
PVC GLUE			CAN.
UNDER-WATER SUPPORT	9	1	EACH
10" SCH. 40 PVC PIPE	10	1	LN., FT.
10" SCH. 40 PVC CAP	11	1	EACH

ITEM	SITE DATA	ACRES
POOL		
DROUGHT POOL		
MINIMUM DRAIN		
MAXIMUM DRAIN		
AVAILABLE WATER AT NORMAL LEVEL		
AVAILABLE WATER AT DROUGHT LEVEL		

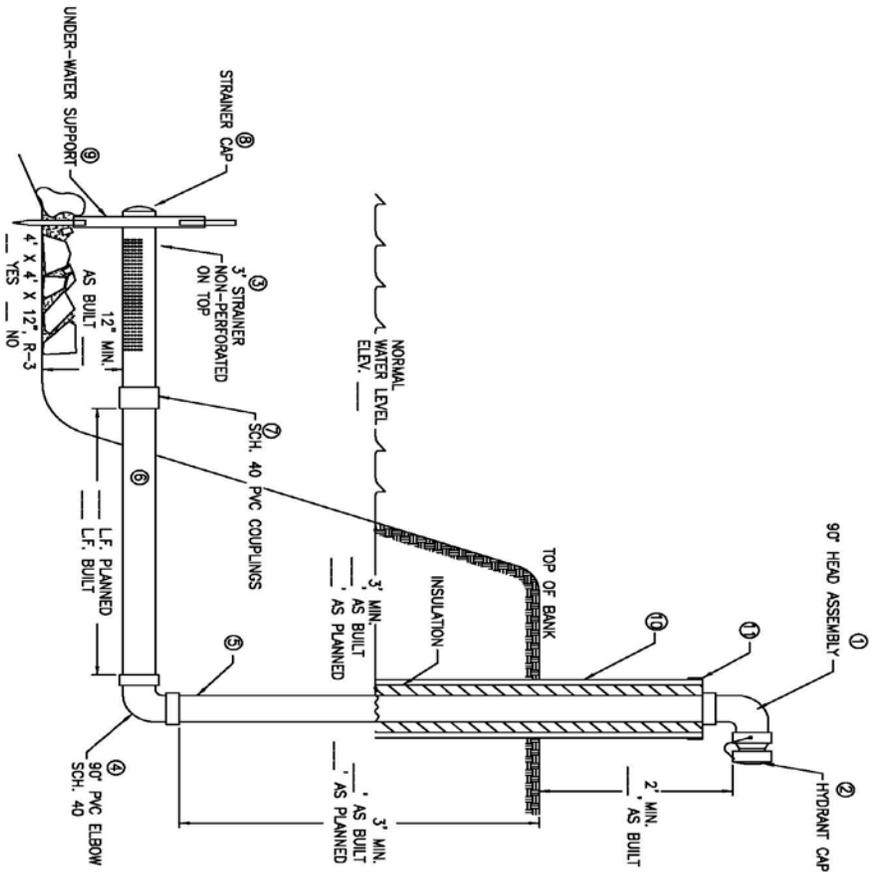

- NOTES:**
- FOR GUARD POSTS, IF REQUIRED, SHALL BE _____
 - UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR CONSTRUCTED FOR LOCAL CONDITIONS.

NOT TO SCALE