

Figure PA 1

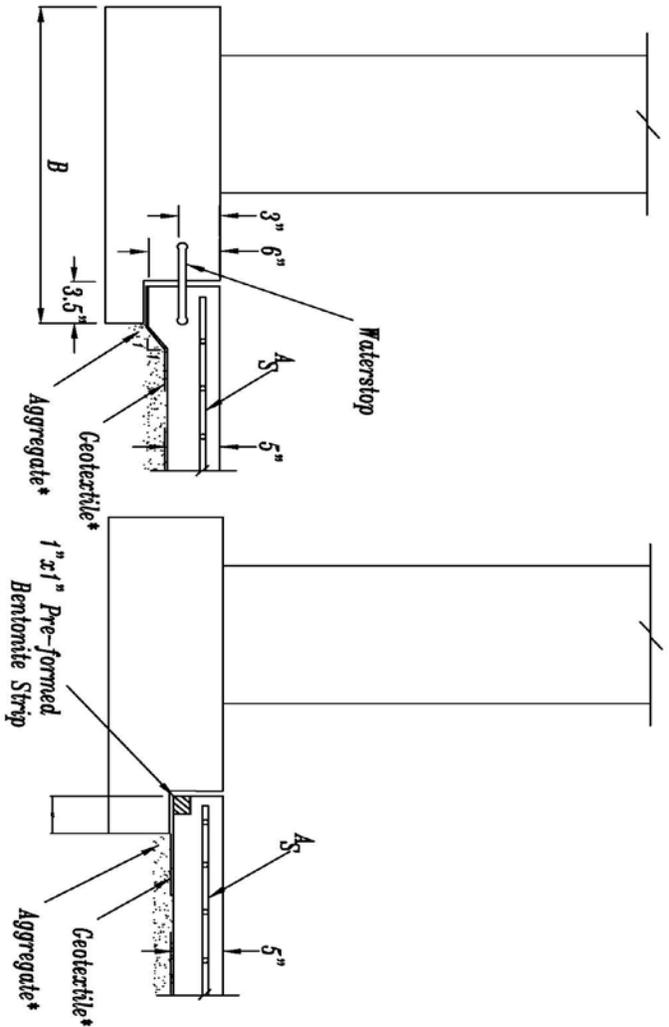


Figure PA 2

Figure PA 3

Distance Between Joints	For 5" Thick Floor	
	A_S	Example
< 30'	.029	6x6-W1.4xW1.4
> 30'	.058	6x6-W2.9xW2.9

* As Specified

NOTES

1. Minimum 3 feet of backfill over top of footing for frost protection.
2. Type I or Type II cement is acceptable.
3. Drainage with 4" CPT (or equivalent) around the tank to an outlet is required.
4. Adhesive should be used to keep bentonite strip in place during floor pour. Tacks/rails should be avoided which may create hard-point contact and cause concrete to spall.
5. See PA-064 for dimension "B".



_____ COUNTY, PENNSYLVANIA
FLOOR/FOOTING ALTERNATIVES

Date: _____
 Drawn: YJA 8/7/06
 Checked: _____
 Approved by: _____

Title: _____
 Date: _____
 Drawn: _____
 Checked: _____
 Approved: _____